

Name of Faculty: Dr. Anand Singh, Vikarm Singh

Designation: Associate Professor, Assistant Professor

Department: Electrical Engineering

Subject: Open Elective EE-604(B) Energy
Conservation and Management

Unit: IV

Topic: Refrigeration & Air Conditioning System

UNIT-04/LECTURE- 01
SUBJECT: Open Elective EE-604(B) Energy Conservation and Management
TOPIC: Refrigeration & Air Conditioning System

1.1 What is Refrigeration and Air Conditioning

Refrigeration and air conditioning is used to cool products or a building environment. The refrigeration or air conditioning system (R) transfers heat from a cooler low-energy reservoir to a warmer high-energy reservoir (see figure 1).

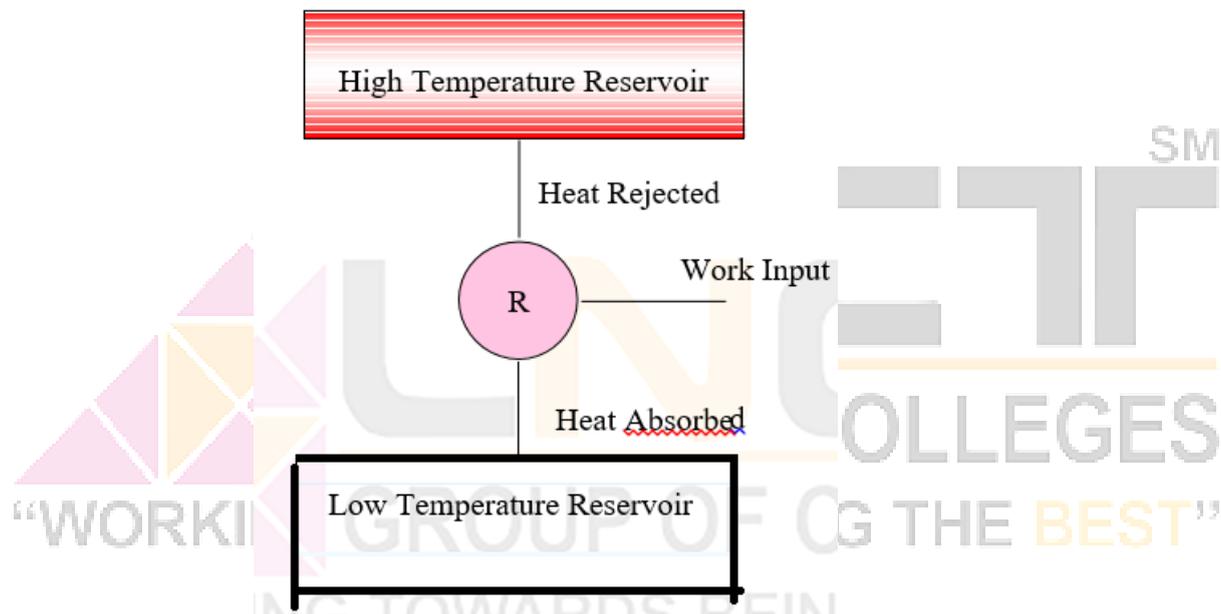


Figure 1. Schematic representation of refrigeration system

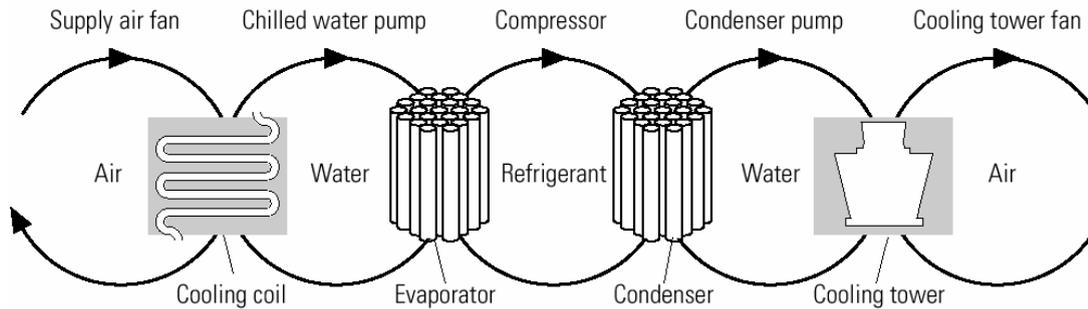


Figure 2. A typical Heat Transfer Loop in Refrigeration System

There are several heat transfer loops in a refrigeration system as shown in Figure 2. Thermal energy moves from left to right as it is extracted from the space and expelled into the outdoors through five loops of heat transfer:

- **Indoor air loop.** In the left loop, indoor air is driven by the supply air fan through a cooling coil, where it transfers its heat to chilled water. The cool air then cools the building space.
- **Chilled water loop.** Driven by the chilled water pump, water returns from the cooling coil to the chiller's evaporator to be re-cooled.
- **Refrigerant loop.** Using a phase-change refrigerant, the chiller's compressor pumps heat from the chilled water to the condenser water.
- **Condenser water loop.** Water absorbs heat from the chiller's condenser, and the condenser water pump sends it to the cooling tower.
- **Cooling tower loop.** The cooling tower's fan drives air across an open flow of the hot condenser water, transferring the heat to the outdoors.

1.2 Air-Conditioning Systems

Depending on applications, there are several options / combinations of air conditioning, which are available for use:

- Air conditioning (for space or machines)
- Split air conditioners
- Fan coil units in a larger system
- Air handling units in a larger system

1.3 Refrigeration Systems (for processes)

The following refrigeration systems exist for industrial processes (e.g. chilling plants) and domestic purposes (modular units, i.e. refrigerators):

- Small capacity modular units of the direct expansion type similar to domestic refrigerators.
- Centralized chilled water plants with chilled water as a secondary coolant for a temperature range over typically 5 °C. They can also be used for ice bank formation.

- Brine plants, which use brines as a lower temperature, secondary coolant for typically sub-zero temperature applications, which come as modular unit capacities as well as large centralized plant capacities.
- The plant capacities up to 50 TR (tons of refrigeration) are usually considered as small capacity, 50 – 250 TR as medium capacity and over 250 TR as large capacity units.

A large company may have a bank of units, often with common chilled water pumps, condenser water pumps, cooling towers, as an off site utility. The same company may also have two or three levels of refrigeration and air conditioning such as a combination of:

- Comfort air conditioning (20 – 25 °C)
- Chilled water system (8⁰ – 10⁰ C)
- Brine system (sub-zero applications)

2. TYPES OF REFRIGERATION AND AIR CONDITIONING

This section describes the two principle types of refrigeration plants found in industry: Vapour Compression Refrigeration (VCR) and Vapour Absorption Refrigeration (VAR). VCR uses mechanical energy as the driving force for refrigeration, while VAR uses thermal energy as the driving force for refrigeration.

2.1 Vapour Compression Refrigeration System

2.1.1 Description

Compression refrigeration cycles take advantage of the fact that highly compressed fluids at a certain temperature tend to get colder when they are allowed to expand. If the pressure change is high enough, then the compressed gas will be hotter than our source of cooling (outside air, for instance) and the expanded gas will be cooler than our desired cold temperature. In this case, fluid is used to cool a low temperature environment and reject the heat to a high temperature environment.

Vapour compression refrigeration cycles have two advantages. First, a large amount of thermal energy is required to change a liquid to a vapor, and therefore a lot of heat can be removed from the air-conditioned space. Second, the isothermal nature of the vaporization allows extraction of heat without raising the temperature of the working fluid to the temperature of whatever is being cooled. This means that the heat transfer rate remains high, because the closer the working fluid temperature approaches that of the surroundings, the lower the rate of heat transfer.

The refrigeration cycle is shown in Figure 3 and 4 and can be broken down into the following stages:

- **1 – 2.** Low-pressure liquid refrigerant in the evaporator absorbs heat from its surroundings, usually air, water or some other process liquid. During this process it changes its state from a liquid to a gas, and at the evaporator exit is slightly superheated.
- **2 – 3.** The superheated vapour enters the compressor where its pressure is raised. The temperature will also increase, because a proportion of the energy put into the compression process is transferred to the refrigerant.
- **3 – 4.** The high pressure superheated gas passes from the compressor into the condenser. The initial part of the cooling process (3-3a) de-superheats the gas before it is then turned

back into liquid (3a-3b). The cooling for this process is usually achieved by using air or water. A further reduction in temperature happens in the pipe work and liquid receiver (3b - 4), so that the refrigerant liquid is sub-cooled as it enters the expansion device.

- **4 - 1** The high-pressure sub-cooled liquid passes through the expansion device, which both reduces its pressure and controls the flow into the evaporator.

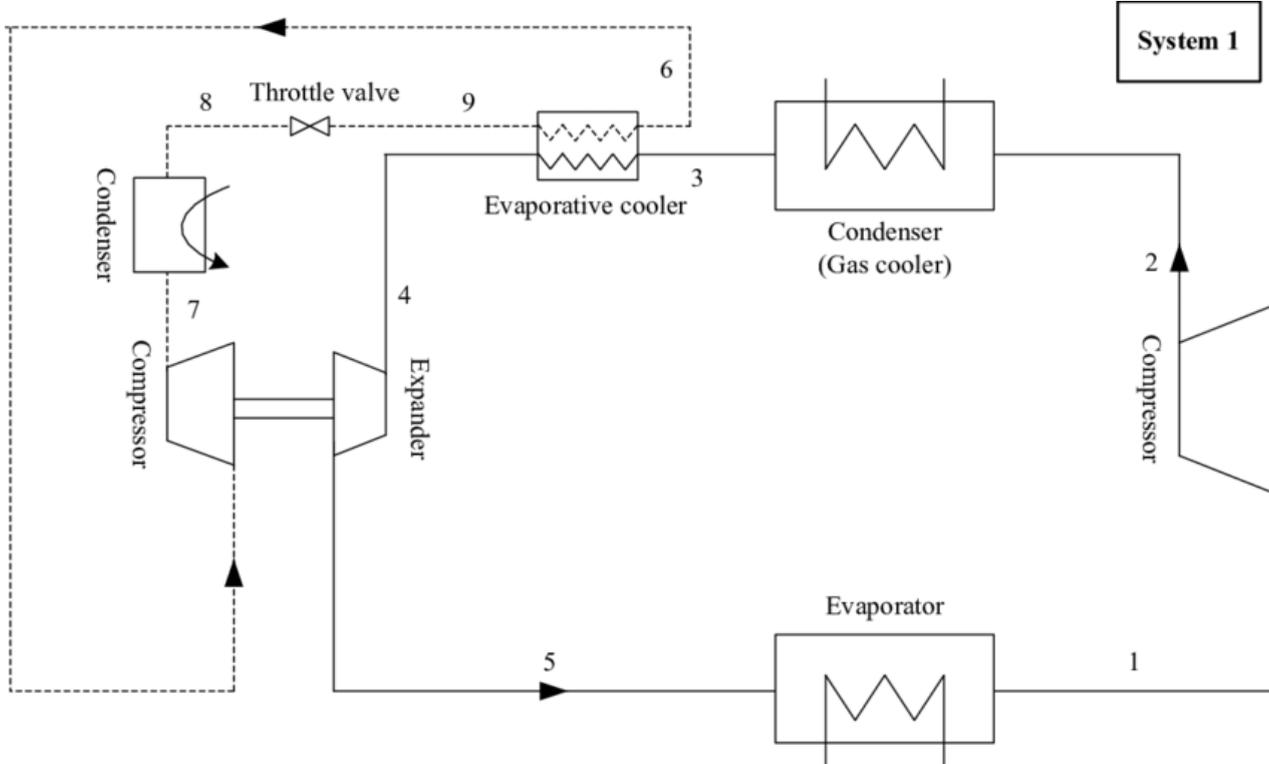


Figure 3. Schematic representation of the vapour compression refrigeration cycle

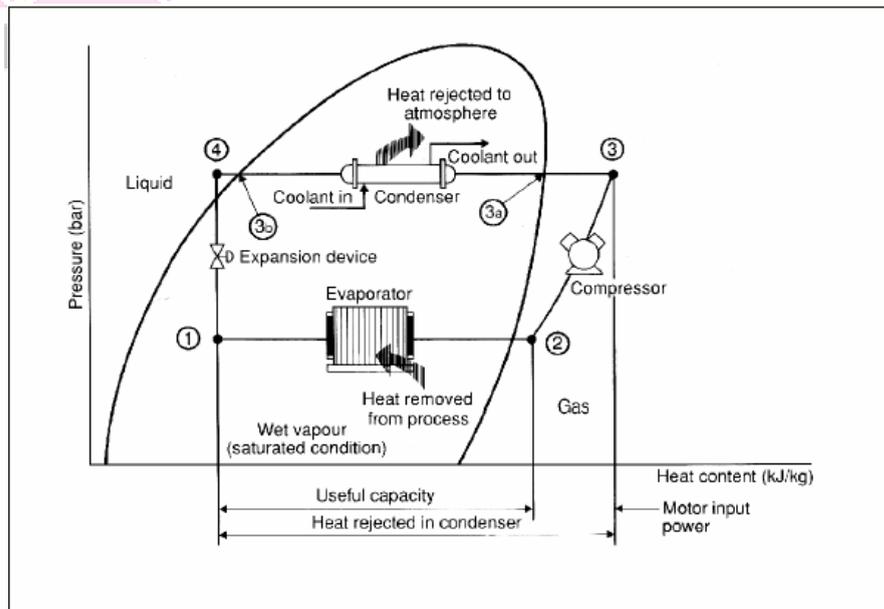


Figure 4. Schematic representation of the refrigeration cycle including pressure changes (Bureau of Energy Efficiency, 2004)

The condenser has to be capable of rejecting the combined heat inputs of the evaporator and the compressor. In other words: (1 - 2) + (2 - 3) has to be the same as (3 - 4). There is no heat loss or gain through the expansion device.

2.1.2 Types of refrigerant used in vapour compression systems

A variety of refrigerants are used in vapor compression systems. The required cooling temperature largely determines the choice of fluid. Commonly used refrigerants are in the family of chlorinated fluorocarbons (CFCs, also called Freons): R-11, R-12, R-21, R-22 and R-502. The properties of these refrigerants are summarized in Table 1 and the performance of these refrigerants is given in Table 2 below.

Table 1. Properties of commonly used refrigerants (

REFRIGERANT	BOILING POINT ** (°C)	FREEZING POINT (°C)	VAPOR PRESSURE *(KPA)	VAPOR VOLUME *(M ³ / KG)	ENTHALPY *	
					Liquid (kJ / kg)	VAPOR (KJ / KG)
R - 11	-23.82	-111.0	25.73	0.61170	191.40	385.43
R - 12	-29.79	-158.0	219.28	0.07702	190.72	347.96
R - 22	-40.76	-160.0	354.74	0.06513	188.55	400.83
R - 502	-45.40	---	414.30	0.04234	188.87	342.31
R - 7 (AMMONIA)	-33.30	-77.7	289.93	0.41949	808.71	487.76
*	At -10 °C					
**	At Standard Atmospheric Pressure (101.325 kPa)					

Table 2. Performance of commonly used refrigerants (adapted from Arora, C.P., 2000)

REFRIGERANT	EVAPORATING PRESS (KPA)	CONDENSING PRESS (KPA)	PRESSURE RATIO	VAPOR ENTHALPY (KJ / KG)	COP ^{**} CAR NOT
R - 11	20.4	125.5	6.15	155.4	5.03
R - 12	182.7	744.6	4.08	116.3	4.70
R - 22	295.8	1192.1	4.03	162.8	4.66
R - 502	349.6	1308.6	3.74	106.2	4.37
R - 717	236.5	1166.5	4.93	103.4	4.78

* At -15 °C Evaporator Temperature, and 30 °C Condenser Temperature

** $COP_{carnot} = \text{Coefficient of Performance} = \text{Temp.}_{Evap.} / (\text{Temp.}_{Cond.} - \text{Temp.}_{Evap.})$

The choice of refrigerant and the required cooling temperature and load determine the choice of compressor, as well as the design of the condenser, evaporator, and other auxiliaries. Additional factors such as ease of maintenance, physical space requirements and availability of utilities for auxiliaries (water, power, etc.) also influence component selection.

2.2 Vapour Absorption Refrigeration System

2.2.1 Description

The vapour absorption refrigeration system consists of:

- Absorber: Absorption of refrigerant vapour by a suitable absorbent or adsorbent, forming a strong or rich solution of the refrigerant in the absorbent/ adsorbent
- Pump: Pumping of the rich solution and raising its pressure to the pressure of the condenser
- Generator: Distillation of the vapour from the rich solution leaving the poor solution for recycling

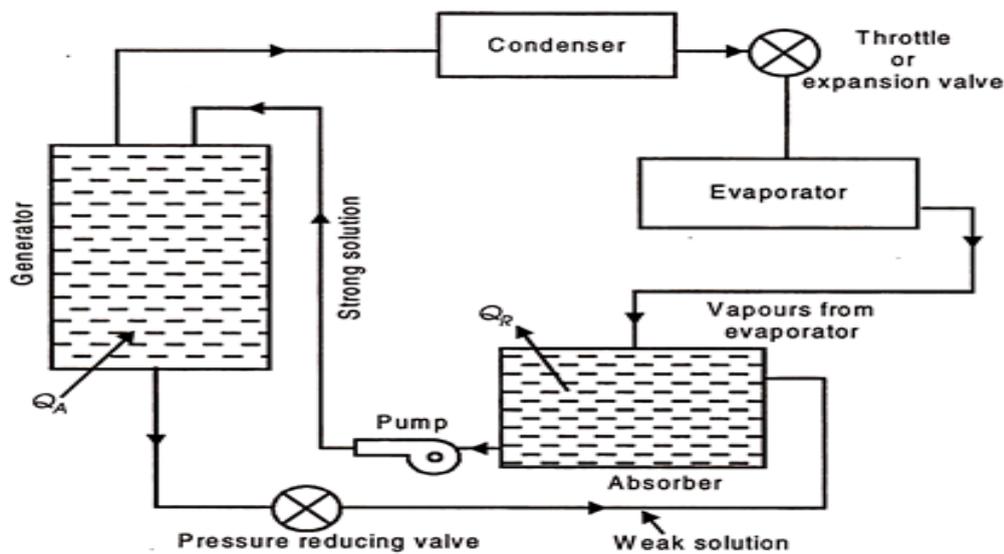


Figure 5: A simple schematic of a vapour absorption refrigeration system

The absorption chiller is a machine, which produces chilled water by using heat such as steam, hot water, gas, oil etc. Chilled water is produced based on the principle that liquid (i.e. refrigerant, which evaporates at a low temperature) absorbs heat from its surroundings when it evaporates. Pure water is used as refrigerant and lithium bromide solution is used as absorbent.

Heat for the vapour absorption refrigeration system can be provided by waste heat extracted from the process, diesel generator sets etc. In that case absorption systems require electricity for running pumps only. Depending on the temperature required and the power cost, it may even be economical to generate heat / steam to operate the absorption system.


A description of the absorption refrigeration concept is given below (references for the pictures are unknown).

Evaporator

The refrigerant (water) evaporates at around 4°C under a high vacuum condition of 754 mm Hg in the evaporator.


Chilled water goes through heat exchanger tubes in the evaporator and transfers heat to the evaporated refrigerant.

The evaporated refrigerant (vapor) turns into liquid again, while the latent heat from this vaporization process cools the chilled water (in the diagram from 12 °C to 7 °C). The chilled water is then used for cooling purposes.

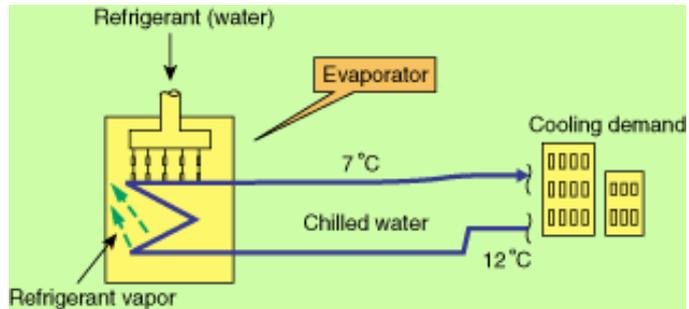

Absorber


In order to keep evaporating, the refrigerant vapor must be discharged from the evaporator and refrigerant (water) must be supplied. The refrigerant vapor is absorbed into lithium bromide solution, which is convenient to absorb the refrigerant vapor in the absorber. The heat generated in the absorption process is continuously removed from the system by cooling water. The absorption also maintains the vacuum inside the evaporator.

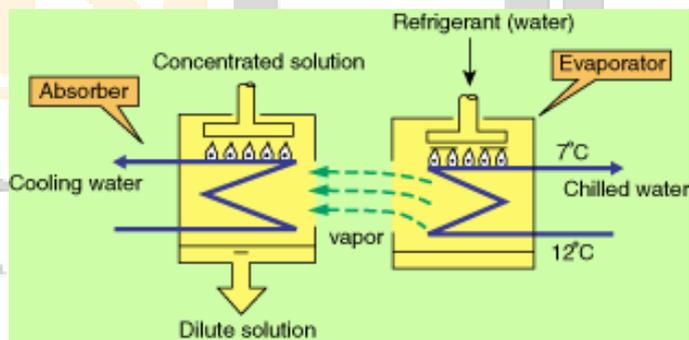

High Pressure Generator

As lithium bromide solution is diluted, the ability to absorb the refrigerant vapor reduces. In order to keep the absorption process going, the diluted lithium bromide solution must be concentrated again.

An absorption chiller is provided with a solution concentrating system, called a generator. Heating media such as steam, hot water, gas or oil perform the function of concentrating

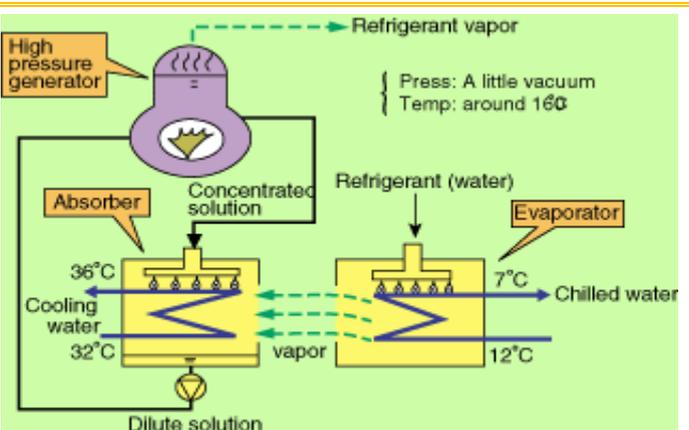


solutions.
 The concentrated solution is returned to the absorber to absorb refrigerant vapor again.

Condenser

To complete the refrigeration cycle, and thereby ensuring the refrigeration takes place continuously, the following two functions are required

1. To concentrate and liquefy the evaporated refrigerant vapor, which is generated in the high-pressure generator.
2. To supply the condensed water to the evaporator as refrigerant (water)

For these two functions a condenser is installed.

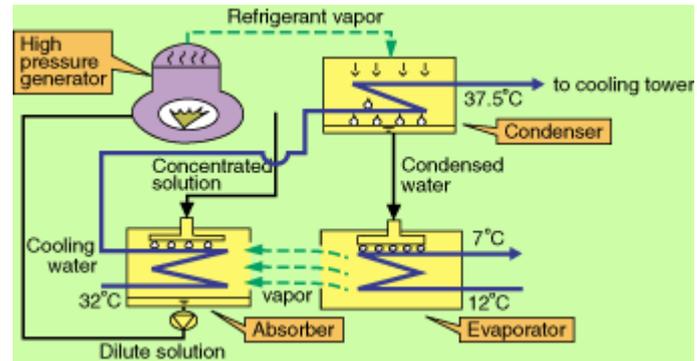

Absorption refrigeration systems that use Li-Br-water as a refrigerant have a Coefficient of Performance (COP) in the range of 0.65 - 0.70 and can provide chilled water at 6.7 °C with a cooling water temperature of 30 °C. Systems capable of providing chilled water at 3 °C are also available. Ammonia based systems operate at above atmospheric pressures and are capable of low temperature operation (below 0°C). Absorption machines are available with capacities in the range of 10-1500 tons. Although the initial cost of an absorption system is higher than that of a compression system, operational costs are much lower if waste heat is used.

2.2.2 Evaporative cooling in vapor absorption refrigeration systems

There are occasions where air conditioning, which stipulates control of humidity of up to 50% for human comfort or for processes, can be replaced by a much cheaper and less energy intensive evaporative cooling.

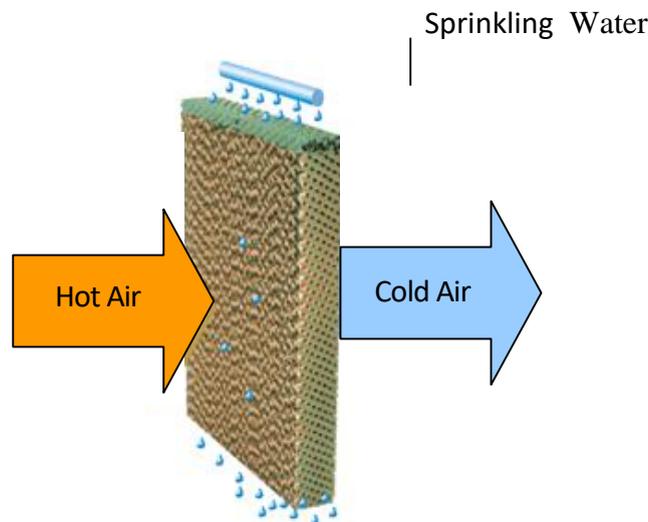


Figure 5. Schematic of evaporative cooling

The concept is very simple and is the same as that used in a cooling tower. Air is brought in close contact with water to cool it to a temperature close to the wet bulb temperature. The cool air can be used for comfort or process cooling. The disadvantage is that the air is rich in moisture. Nevertheless, it is an extremely efficient means of cooling at very low cost. Large commercial systems employ cellulose filled pads over which water is sprayed. The temperature can be controlled by controlling the airflow and the water circulation rate. The possibility of evaporative cooling is especially attractive for comfort cooling in dry regions. This principle is practiced in textile industries for certain processes.

3. ASSESSMENT OF REFRIGERATION AND AIR CONDITIONING

This section describes how the performance of refrigeration / air conditioning plants and be assessed.

3.1 Assessment of Refrigeration

3.1.1 TR

We start with the definition of TR.

- TR: the cooling effect produced is quantified as tons of refrigeration, also referred to as "chiller tonnage".

- $TR = Q \times C_p \times (T_i - T_o) / 3024$

Where

Q is mass flow rate of coolant in kg/hr

C_p is coolant specific heat in kCal /kg deg C

T_i is inlet, temperature of coolant to evaporator (chiller) in $^{\circ}C$

T_o is outlet temperature of coolant from evaporator (chiller) in $^{\circ}C$.

1 TR of refrigeration = 3024 kCal/hr heat rejected

3.1.2 Specific Power Consumption

- The specific power consumption kW/TR is a useful indicator of the performance of a refrigeration system. By measuring the refrigeration duty performed in TR and the kW inputs, kW/TR is used as an energy performance indicator.
- In a centralized chilled water system, apart from the compressor unit, power is also consumed by the chilled water (secondary) coolant pump, the condenser water pump (for heat rejection to cooling tower) and the fan in the cooling tower. Effectively, the overall energy consumption would be the sum of:
 - Compressor kW
 - Chilled water pump kW
 - Condenser water pump kW
 - Cooling tower fan kW, for induced / forced draft towers
- The kW/TR, or the specific power consumption for a certain TR output is the sum of:
 - Compressor kW/TR
 - Chilled water pump kW/TR
 - Condenser water pump kW/TR
 - Cooling tower fan kW/TR

3.1.3 Coefficient of Performance

- The theoretical Coefficient of Performance (Carnot), (COP_{Carnot} , a standard measure of refrigeration efficiency of an ideal refrigeration system) depends on two key system temperatures: evaporator temperature T_e and condenser temperature T_c . COP is given as:

$$COP_{Carnot} = T_e / (T_c - T_e)$$

This expression also indicates that higher COP_{Carnot} is achieved with higher evaporator temperatures and lower condenser temperatures. But COP_{Carnot} is only a ratio of temperatures, and does not take into account the type of compressor. Hence the COP normally used in industry is calculated as follows:

$$COP = \frac{\text{Cooling effect (kW)}}{\text{Power input to compressor (kW)}}$$

where the cooling effect is the difference in enthalpy across the evaporator and expressed as kW.

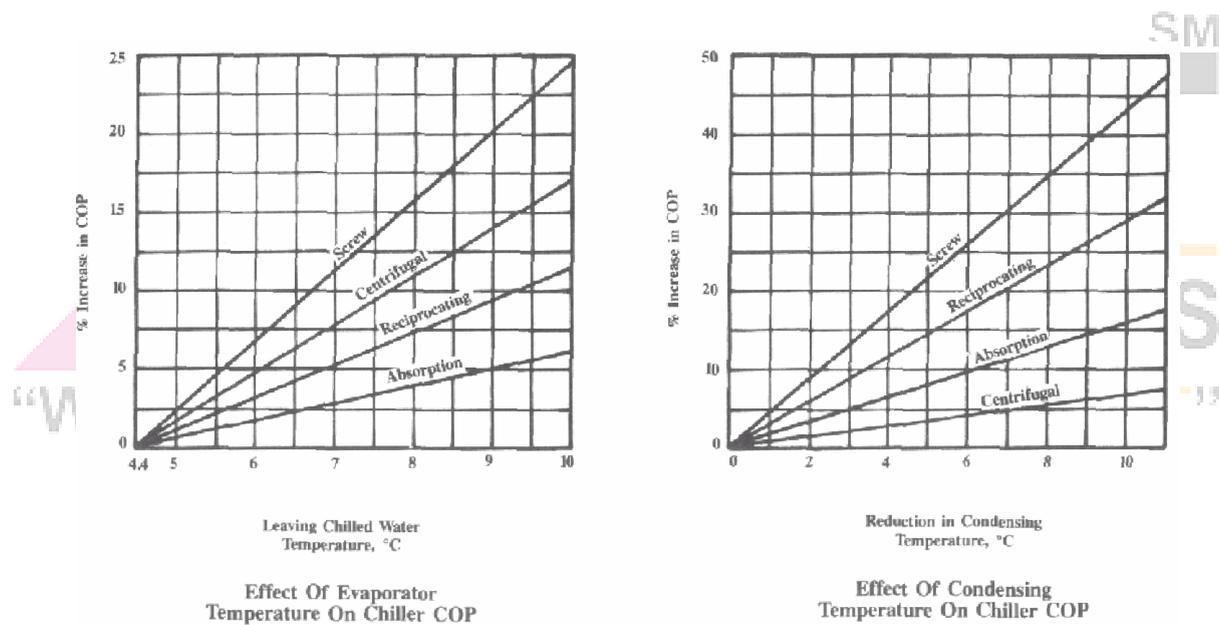


Figure 6: The effect of condensing temperature and evaporator temperature on the chiller (Bureau of Energy Efficiency, 2004)

3.2 Assessment of Air Conditioning

For air conditioning units, the airflow at the Fan Coil Units (FCU) or the Air Handling Units (AHU) can be measured with an anemometer. Dry bulb and wet bulb temperatures are measured at the inlet and outlet of the AHU or the FCU and the refrigeration load in TR is assessed as:

$$TR = \frac{Q \times \rho \times (h_{in} - h_{out})}{3024}$$

Where, Q is the air flow in m^3/h
 ρ is density of air kg/m^3
 h_{in} is enthalpy of inlet air kCal/kg
 h_{out} is enthalpy of outlet air kCal/kg

Use of psychometric charts can help to calculate h_{in} and h_{out} from dry bulb and wet bulb temperature values which are measured during trials by a whirling psychrometer. Power measurements at compressor, pumps, AHU fans, cooling tower fans can be taken with a portable load analyzer.

Estimation of the air conditioning load is also possible by calculating various heat loads, sensible and latent, based on inlet and outlet air parameters, air ingress factors, air flow, number of people and type of materials stored.

An indicative TR load profile for air conditioning is presented as follows:

- Small office cabins = $0.1 \text{ TR}/\text{m}^2$
- Medium size office i.e.,
10 – 30 people occupancy
with central A/C = $0.06 \text{ TR}/\text{m}^2$
- Large multistoried office
complexes with central A/C = $0.04 \text{ TR}/\text{m}^2$

3.3 Considerations when Assessing Performance

3.3.1 Accuracy of flow and temperature measurements

In a field performance assessment, accurate instruments are required to measure the inlet and outlet temperatures of chilled water and condenser water, preferably with a count of at least $0.1 \text{ }^\circ\text{C}$. Flow measurements of chilled water can be made with an ultrasonic flow meter directly or can be determined based on pump duty parameters. Adequacy checks of chilled water are often needed and most units are designed for a typical $0.68 \text{ m}^3/\text{hr}$ per TR (3 gpm/TR) chilled water flow. Condenser water flow can also be measured with a non-contact flow meter directly or determined by using pump duty parameters. Adequacy checks of condenser water are also needed often, and most units are designed for a typical $0.91 \text{ m}^3/\text{hr}$ per TR (4 gpm / TR) condenser water flow.

3.3.2 Integrated Part Load Value (IPLV)

Although the kW/TR can serve as an initial reference, it should not be taken as an absolute since this value is based on a 100% equipment capacity level and on design conditions that are considered most critical. These conditions may only occur during % of the total time the equipment is in operation throughout the year. For this reason, it is essential to have data that reflects how the equipment operates with partial loads or under conditions that demand less than 100% capacity. To overcome this, an average kW/TR with partial loads has to be determined, which is called the Integrated Part Load Value (IPLV).

The IPLV is the most appropriate reference, although not considered the best, because it only captures four points within the operational cycle: 100%, 75%, 50% and 25%. Furthermore, it

assigns the same weight to each value, and most equipment operate between 50% and 75% of their capacity. This is why it is so important to prepare a specific analysis for each case that addresses the four points mentioned, as well as developing a profile of the heat exchanger's operations during the year.

4. ENERGY EFFICIENCY OPPORTUNITIES

This section includes areas for energy conservation in refrigeration plants.

4.1 Optimization of Process Heat Exchangers

There is a tendency to apply high safety margins to operations, which influence the compressor suction pressure / evaporator set point. For instance, a process-cooling requirement of 15 °C would need chilled water at a lower temperature, but the range can vary from 6 °C to about 10 °C. At chilled water of 10 °C, the refrigerant side temperature has to be lower (about -5°C to +5°C). The refrigerant temperature determines the corresponding suction pressure of the refrigerant, which in turn determines the inlet duty conditions for the refrigerant compressor. Applying the optimum / minimum driving force (temperature difference) can thus help to reach the highest possible suction pressure at the compressor, thereby minimizing energy consumption. This requires proper sizing of heat transfer areas of process heat exchangers and evaporators as well as rationalizing the temperature requirement to highest possible value. A 1°C raise in evaporator temperature can save almost 3 % of the power consumed. The TR capacity of the same machine will also increase with the evaporator temperature, as given in the table below.

Table 3. Typical values illustrating the effect of variation in evaporator temperature on the compressor power consumption

Evaporator Temperature (°C)	Refrigeration Capacity* (tons)	Specific Power Consumption	Increase in kW/ton (%)
5.0	67.58	0.81	-
0.0	56.07	0.94	16.0
-5.0	45.98	1.08	33.0
-10.0	37.20	1.25	54.0
-20.0	23.12	1.67	106.0

* Condenser temperature 40°C

In order to rationalize the heat transfer areas, the heat transfer coefficient on the refrigerant side can range from 1400 – 2800 watts /m²K. The refrigerant side heat transfer areas are of the order of 0.5 m²/TR and above in evaporators.

Condensers in a refrigeration plant are critical equipment that influence the TR capacity and power consumption demands. For any refrigerant, the condensation temperature and corresponding condenser pressure are dependent on the heat transfer area, the effectiveness of heat exchange and the type of cooling chosen. A lower condensation temperature means that the compressor has to work between a lower pressure differential as the discharge pressure is fixed by design and performance of the condenser.

The choice of condensers in practice is between air-cooled, air-cooled with water spray, and heat exchanger cooled. Larger shell and tube heat exchangers that are used as condensers and

that are equipped with good cooling tower operations allow operation at low discharge pressure values and improve the TR capacity of the refrigeration plant.

If the refrigerant R22 is used in a water-cooled shell and tube condenser then the discharge pressure is 15 kg/cm². If the same refrigerant is used in an air-cooled condenser then the discharge pressure is 20 kg/cm². This shows how much additional compression duty is required, which results in almost 30 % additional energy consumption by the plant.

One of the best options at the design stage would be to select large sized (0.65 m²/TR and above) shell and tube condensers with water-cooling, rather than less expensive alternatives like air cooled condensers or water spray atmospheric condenser units.

The effect of condenser temperature on refrigeration plant energy requirements is given in the table below

Table 7. Typical values illustrating the effect of variation in condenser temperature on compressor power consumption (National Productivity Council, unpublished)

Condensing Temperature (°C)	Refrigeration Capacity (tons)	Specific Power Consumption (kW / TR)	Increase in kW/TR (%)
26.7	31.5	1.17	-
35.0	21.4	1.27	8.5
40.0	20.0	1.41	20.5

* Reciprocating compressor using R-22 refrigerant.

Evaporator temperature -10°C

4.2 Maintenance of Heat Exchanger Surfaces

Once compressors have been purchased, effective maintenance is the key to optimizing power consumption. Heat transfer can also be improved by ensuring proper separation of the lubricating oil and the refrigerant, timely defrosting of coils, and increasing the velocity of the secondary coolant (air, water, etc.). However, increased velocity results in larger pressure drops in the distribution system and higher power consumption in pumps / fans. Therefore, careful analysis is required to determine the optimum velocity.

Fouled condenser tubes force the compressor to work harder to attain the desired capacity. For example, a 0.8 mm scale build-up in condenser tubes can increase energy consumption by as much as 35 %. Similarly, fouled evaporators (due to residual lubricating oil or infiltration of air) result in increased power consumption. Equally important is proper selection, sizing, and maintenance of cooling towers. A reduction of 0.55°C in temperature of the water returning from the cooling tower reduces compressor power consumption by 3%.

Table 8. Typical values illustrating the effect of poor maintenance on compressor power consumption (National Productivity Council)

Condition	Evaporation Temp (°C)	Condensation Temp (°C)	Refrigeration Capacity* (tons)	Specific Power Consumption (kW/ton)	Increase in kW/Ton (%)
Normal	7.2	40.5	17.0	0.69	-
Dirty condenser	7.2	46.1	15.6	0.84	20.4
Dirty evaporator	1.7	40.5	13.8	0.82	18.3
Dirty condenser and evaporator	1.7	46.1	12.7	0.96	38.7

4.3 Multi-Staging For Efficiency

Efficient compressor operation requires that the compression ratio be kept low, to reduce discharge pressure and temperature. For low temperature applications involving high compression ratios, and for wide temperature range requirements, it is preferable (due to equipment design limitations) and often economical to employ multi-stage reciprocating machines or centrifugal / screw compressors.

There are two types of multi-staging systems, which are applicable to all types of compressors: compound and cascade. With reciprocating or rotary compressors, two-stage compressors are preferable for load temperatures from -20°C to -58°C , and with centrifugal machines for temperatures around -43°C .

In a multi-stage operation, a first-stage compressor that sized to meet the cooling load, feeds into the suction of a second-stage compressor after inter-cooling of the gas. A part of the high-pressure liquid from the condenser is flashed and used for liquid sub-cooling. The second compressor, therefore, has to meet the load of the evaporator and the flash gas. A single refrigerant is used in the system, and the two compressors share the compression task equally. Therefore, a combination of two compressors with low compression ratios can provide a high compression ratio.

For temperatures in the range of -46°C to -101°C , cascaded systems are preferable. In this system, two separate systems using different refrigerants are connected so that one rejects heat to the other. The main advantage of this system is that a low temperature refrigerant, which has a high suction temperature and low specific volume, can be selected for the low- stage to meet very low temperature requirements.

4.4 Matching Capacity to System Load

During part- load operation, the evaporator temperature rises and the condenser temperature falls, effectively increasing the COP. But at the same time, deviation from the design operation point and the fact that mechanical losses form a greater proportion of the total power negate the effect of improved COP, resulting in lower part- load efficiency.

Therefore, consideration of part-load operation is important, because most refrigeration applications have varying loads. The load may vary due to variations in temperature and process cooling needs. Matching refrigeration capacity to the load is a difficult exercise, requiring knowledge of compressor performance, and variations in ambient conditions, and detailed knowledge of the cooling load.

4.5 Capacity Control and Energy Efficiency

The capacity of compressors is controlled in a number of ways. Capacity control of reciprocating compressors through cylinder unloading results in incremental (step-by-step) modulation. In contrast, continuous modulation occurs in centrifugal compressors through vane control and in screw compressors through sliding valves. Therefore, temperature control requires careful system design. Usually, when using reciprocating compressors in

applications with widely varying loads, it is desirable to control the compressor by monitoring the return water (or other secondary coolant) temperature rather than the temperature of the water leaving the chiller. This prevents excessive on-off cycling or unnecessary loading / unloading of the compressor. However, if load fluctuations are not high, the temperature of the water leaving the chiller should be monitored. This has the advantage of preventing operation at very low water temperatures, especially when flow reduces at low loads. The outgoing water temperature should be monitored for centrifugal and screw chillers.

Capacity regulation through speed control is the most efficient option. However, when employing speed control for reciprocating compressors, it should be ensured that the lubrication system is not affected. In the case of centrifugal compressors, it is usually desirable to restrict speed control to about 50 % of the capacity to prevent surging. Below 50%, vane control or hot gas bypass can be used for capacity modulation.

The efficiency of screw compressors operating at part load is generally higher than either centrifugal compressors or reciprocating compressors, which may make them attractive in situations where part- load operation is common. Screw compressor performance can be optimized by changing the volume ratio. In some cases, this may result in higher full- load efficiencies as compared to reciprocating and centrifugal compressors. Also, the ability of screw compressors to tolerate oil and liquid refrigerant slugs makes them preferred in some situations.

4.6 Multi-level Refrigeration for Plant Needs

The selection of refrigeration systems also depends on the range of temperatures required in the plant. For diverse applications requiring a wide range of temperatures, it is generally more economical to provide several packaged units (several units distributed throughout the plant) instead of one large central plant. Another advantage would be the flexibility and reliability. The selection of packaged units could also be made depending on the distance at which cooling loads need to be met. Packaged units at load centers reduce distribution losses in the system. Despite the advantages of packaged units, central plants generally have lower power consumption since at reduced loads power consumption can reduce significantly due to the large condenser and evaporator surfaces.

Many industries use a bank of compressors at a central location to meet the load. Usually the chillers feed into a common header from which branch lines are taken to different locations in the plant. In such situations, operation at part- load requires extreme care. For efficient operation, the cooling load, and the load on each chiller must be monitored closely. It is more efficient to operate a single chiller at full load than to operate two chillers at part- load. The distribution system should be designed such that individual chillers can feed all branch lines. Isolation valves must be provided to ensure that chilled water (or other coolant) does not flow through chillers not in operation. Valves should also be provided on branch lines to isolate sections where cooling is not required. This reduces pressure drops in the system and reduces power consumption in the pumping system. Individual compressors should be loaded to their full capacity before operating the second compressor. In some cases it is economical to provide a separate smaller capacity chiller, which can be operated on an on-off control to meet peak demands, with larger chillers meeting the base load.

Flow control is also commonly used to meet varying demands.

In such cases the savings in pumping at reduced flow should be weighed against the reduced heat transfer in coils due to reduced velocity. In some cases, operation at normal flow rates, with subsequent longer periods of no-load (or shut-off) operation of the compressor, may result in larger savings.

4.7 Chilled Water Storage

Depending on the nature of the load, it is economical to provide a chilled water storage facility with very good cold insulation. Also, the storage facility can be fully filled to meet the process requirements so that chillers need not be operated continuously. This system is usually economical if small variations in temperature are acceptable. This system has the added advantage of allowing the chillers to be operated at periods of low electricity demand to reduce peak demand charges. Low tariffs offered by some electric utilities for operation at nighttime can also be taken advantage of by using a storage facility. An added benefit is that lower ambient temperature at night lowers condenser temperature and thereby increases the COP.

If temperature variations cannot be tolerated, it may not be economical to provide a storage facility since the secondary coolant would have to be stored at a temperature much lower than required to provide for heat gain. The additional cost of cooling to a lower temperature may offset the benefits. The solutions are case specific. For example, in some cases it may be possible to employ large heat exchangers, at a lower cost burden than low temperature chiller operation, to take advantage of the storage facility even when temperature variations are not acceptable. Ice bank systems, which store ice rather than water, are often economical.

4.8 System Design Features

In overall plant design, adoption of good practices improves the energy efficiency significantly. Some areas for consideration are:

- Design of cooling towers with FRP impellers and film fills, PVC drift eliminators, etc.
- Use of softened water for condensers in place of raw water.
- Use of economic insulation thickness on cold lines, heat exchangers, considering cost of heat gains and adopting practices like infrared thermography for monitoring - applicable especially in large chemical / fertilizer / process industry.
- Adoption of roof coatings / cooling systems, false ceilings / as applicable, to minimize refrigeration load.
- Adoption of energy efficient heat recovery devices like air to air heat exchangers to pre-cool the fresh air by indirect heat exchange; control of relative humidity through indirect heat exchange rather than use of duct heaters after chilling.

Adopting of variable air volume systems; adopting of sun film application for heat reflection; optimizing lighting loads in the air conditioned areas; optimizing number of air changes in the air conditioned areas are few other example

Assignment Question:-

- Q.1 Explain the Principle Of Refrigeration?
- Q.2 What Is Air Conditioners?
- Q.3 What Is Mechanical Refrigeration? Classify The Different Refrigeration Systems?
- Q.4 Explain the Refrigeration Systems?
- Q.5 Explain the Optimization of Process Heat Exchangers?
- Q.6 Explain the Maintenance of Heat Exchanger Surfaces?
- Q.7 Explain the Vapour Absorption Refrigeration System?

Bibliography

- Arora, C.P. Refrigeration and Air Conditioning. Second edition. Tata McGraw-Hill Publishing Company Ltd. 2000.
- Jankovic Zvonimir, Atienza Jaime Sieres, Martínez Suarez Jose Antonio. Thermodynamic and heat transfer analyses for R1234yf and R1234ze(E) as drop-in replacements for R134a in a small power refrigerating system. *Appl Therm Eng* 2015;80:42–54.
- Yang M-Hsiung, Yeh Ro-Hua. Thermo-economic optimization of an organic Rankine cycle system for large marine diesel engine waste heat recovery. *Energy* 2015;82:256–68.
- Wang YC, Tang GH. Prediction of sulfuric acid dew point temperature on heat transfer fin surface. *Appl Therm Eng* 2016;98:492–501.
- Shenshen Su, Fang Xuekun, Li Li, Jing Wu, Zhang Jianbo, Weiguang Xu, et al. HFC-134a emissions from mobile air conditioning in China from 1995 to 2030. *Atmos Environ* 2015;102:122–9.
- Lee Yohan, Jung Dongsoo. A brief performance comparison of R1234yf and R134a in a bench tester for automobile applications. *Appl Therm Eng* 2012;35:240–2.
- Golzari Soudabeh, Kasaeian Alibakhsh, Daviran Samaneh, Mahian Omid, Wongwises Somchai, Sahin Ahmet Z. Second law analysis of an automotive air conditioning system using HFO-1234yf, an environmentally friendly refrigerant. *Int J Refrig* 2017;73:134–43.
- Bureau of Energy Efficiency, Ministry of Power, India. HVAC and Refrigeration Systems. In: Energy Efficiency in Electrical Utilities, chapter 4. 2004
- Compare India. www.compareindia.comunters. Pre-Cooling of Gas Turbines – Evaporative Cooling. 2001.
- www.munters.com/home.nsf/FS1?ReadForm&content=/products.nsf/ByKey/OHAA-55GSWH
- National Productivity Council, Ministry of Industries, India. Technology Menu on Energy Efficiency.